


# ARI CONLIFT®

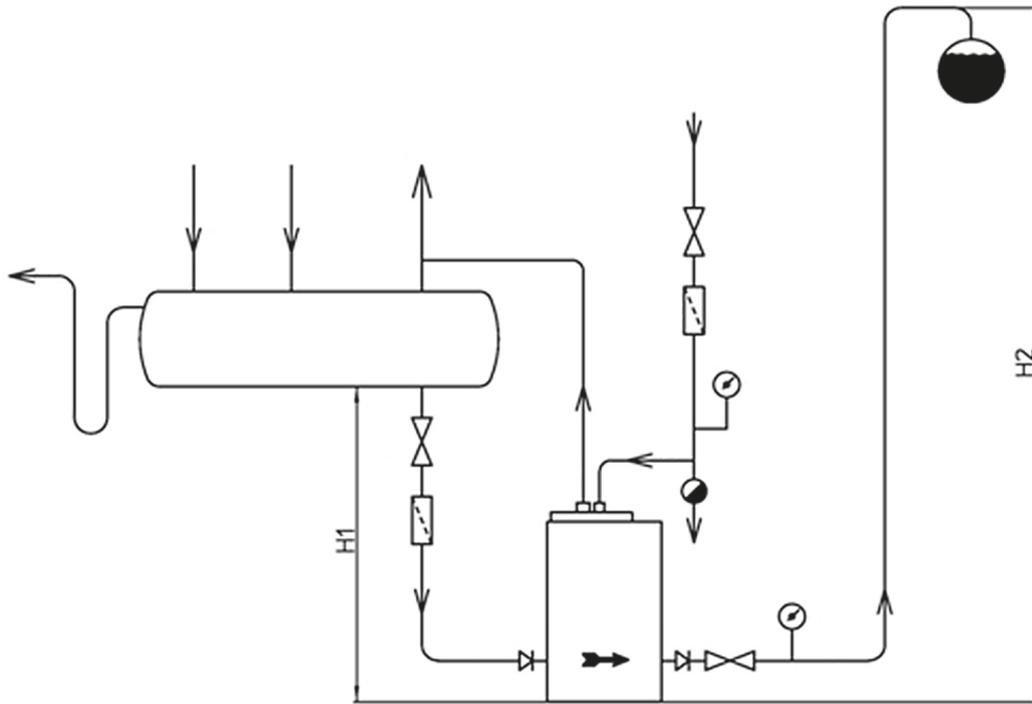

Installationsschema  
installation chart

Kondensatmenge / condensate quantity	.....	kg/h	.....	lb/hr
Zulaufhöhe (H1) / filling head (H1)	.....	mm	.....	inch
Treibdampfdruck / motive steam pressure	.....	bar	.....	psi
Gesamtgegendruck / total back pressure	.....	bar	.....	psi
oder / or				
Druck Kondensatsammelleitung / pressure main condensate line	.....	bar	.....	psi
+				
Förderhöhe (H2) / lifting height (H2)	.....	m	.....	yd
+				
Förderleitungslänge / feed pipe length	.....	m	.....	yd
+				
Nennweite Förderleitung / feed pipe	.....	mm	.....	inch

Nennweite / nominal size	DN25	DN40	DN50	DN80	Herst. Vorgabe / manu. spec.
--------------------------	------	------	------	------	------------------------------

Medium / medium	Dampf / steam	Druckluft / compressed air
Ausführung / construction	P235GH	EN-JS1049
Isolierung / isolation	ja / yes	nein / no
Hubzähler / stroke counter	ja / yes	nein / no
Innendruckmanometer / pressure gauge	ja / yes	nein / no
Entwässerungskugelhahn / drain ball valve	ja / yes	nein / no

Sonstiges /others